



Flow switch

QVE1901

for liquids in piping DN 20...200.

-
- **Contact load / switching capacity:** max. AC 230 V, 1 A, 26 VA
max. DC 48 V, 1 A, 20 W
 - **Nominal pressure PN25**
 - **Manual setting of contact type (NO / NC)**
 - **Housing IP 65 / safety class II**
 - **Maintenance free**

Mode of operation


Flow monitor of liquid medium in HVAC plants in hydraulic systems, in particular, refrigeration, heat pump and heating plants, e.g. for evaporators, boilers, heat exchangers, etc.

Ordering

When ordering, please provide the name and product number:
Flow switch **QVE1901**

Mechanical design

The device records the flow of monitored medium via a paddle system (1), which has a permanent magnet (2) attached at its upper end. A reed contact (3) is positioned outside the flow above this magnet. A second magnet (4) with opposite polarity is used to create a reset force. The paddle system moves once it comes into contact with the monitored flow. The magnet (2) changes its position to the reed contact (3). The contact opens/closes depending on the contact type. As soon as the flow is interrupted, the paddle returns to its original position and the reed contact opens/closes depending on the contact type. (See "Adjusting the switching unit" on page 5)

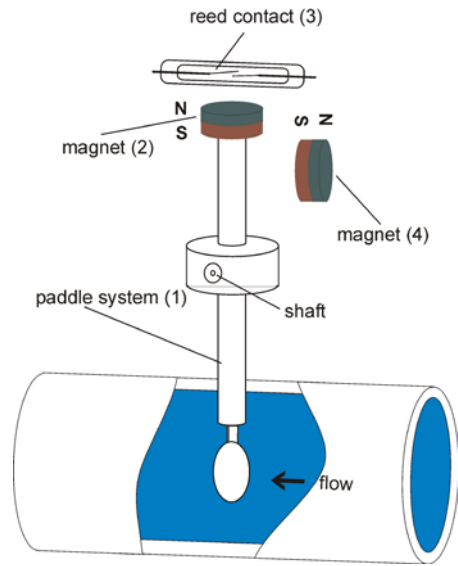

Engineering notes



- On site, a T-junction 1/2" thread per EN DIN 10241 required (steel fittings with threads) and EN DIN 10242 (threaded fitting from malleable casting) required
- All dimensions and data provided in the table of switching values are based on water at 20 °C, the use of T-junctions and **horizontal** piping
- Before and after the mounting location of the flow switch, a smoothing path of at least 10 times or 5 times respectively the nominal pipe diameter required

You can shorten the paddles to adapt the nominal size, maximum flow, and switching point adjustment. Refer to table on page 9.

Flow switch installation


Mechanical installation General installation instructions

- When choosing the installation site, ensure that the specified limit values (see "Technical Data") are not exceeded.
- Select suitable measures to prevent the medium from freezing. If the flow switch is to be used in ambient temperatures of $<4^{\circ}\text{C}$, do not carry out any operation beforehand using pure water. Residual water in the flow switch can result in frost damage.
- First, clean the pipe system where the flow switch is installed and remove any magnetic particles, e.g. welding residue.
- The smoothing section in front of and behind the flow switch must be at least 10 times or 5 times respectively.
- The nominal installation position of the flow switch is "upright standing position" in horizontal pipework.
- The switches should only be installed in a vertical position; deviation max. of 45° .
- Please make sure that there are no external magnetic fields in the immediate vicinity of the flow switch, since these can impair device operation.
- There is an arrow on the flow switch. Ensure during installation that the arrow is parallel with the pipe shaft and is facing in the flow direction.

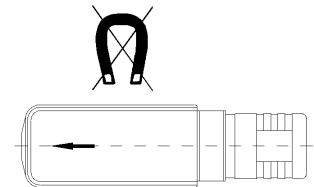

- The brass connecting nut $G\frac{3}{4}$ has a tightening torque of 25...30 Nm.

DN20...200

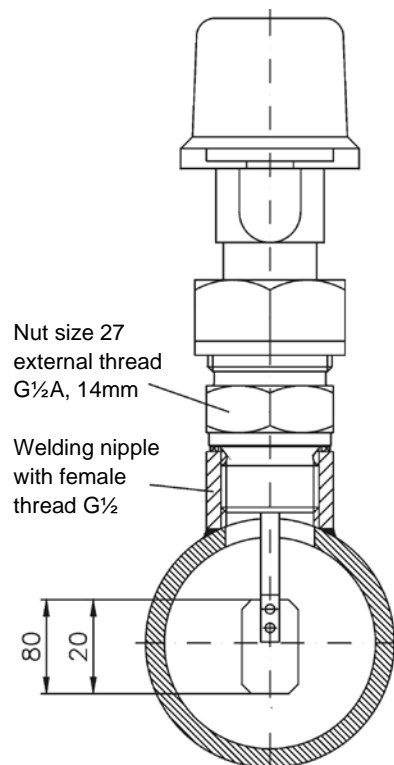

Installation notes

- Observe all local regulations from the electrical utilities or waterworks as applicable
- Allow for an extra loop of the connecting cable to ensure the switching value can be adjusted

Electrical connections

Warning



- **Danger of death due to electrical voltage!**
Work on electrical installations may only be carried out by qualified electricians or by instructed persons working under the guidance and supervision of a qualified electrician, in accordance with the electrical regulations.
Always de-energize the system before connecting the wires of the mains cable.
- **CAUTION:** Ensure that the maximum electrical contact load specified on the type plate is never exceeded; otherwise the reed contact integrated in the switching unit will be damaged.
Inductive loads impair switching capacity. Please ask the manufacturer for information on protective circuits.




Fig. 1




Fig. 2




Fig. 3


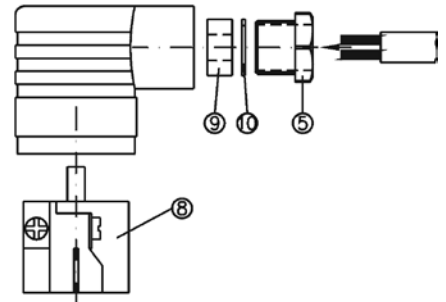


Fig. 4

- Loosen the central screw (pos. 6) M3x35 and disconnect the junction box EN 175301-803-A (pos. 2) from the connector (pos. 1, Fig. 1).
- Use a screwdriver or similar tool to press out the core (pos. 8) of the junction box (Fig. 2).
- Loosen the screw connection PG 9 (pos. 5, Fig. 3).
- Feed the connecting cable into the junction box via the screw connection (pos. 5), the clamping ring (pos. 10) and the rubber insert (pos. 9) and subsequently connect the wires as displayed in the connection diagram (see Fig. 4).

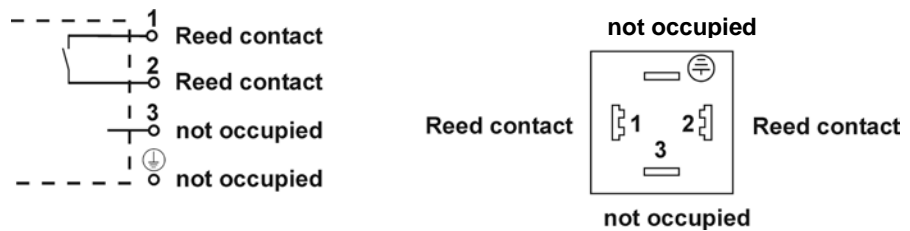

- Press the core (pos. 8) until it locks into position in the junction box (pos. 2).
- Tighten the cable gland PG 9 (pos. 5).
- Place the junction box (pos. 2) on the connector (pos. 1) and retighten the central screw (pos. 6).
- To guarantee the protection class IP 65 per EN 60529, the applied connecting cable has to have a sheathing diameter of between 4.5 and 7 mm.
- Furthermore, ensure that all the connector seals (pos. 3, 4 and 9) have been correctly inserted.

Adjust switching unit


Standard contact

The flow switch can be operated as NO (normally open) or NC (normally close). The following table explains the two contact types:

Contact type	Setting	Flow rate	Electric contact
Make contact (NO)	RED arrow	increasing	closing
		decreasing	opening
Break contact (NC)	WHITE or BLUE arrow	increasing	opening
		decreasing	closing

Open switching head

- Open the plug cover.

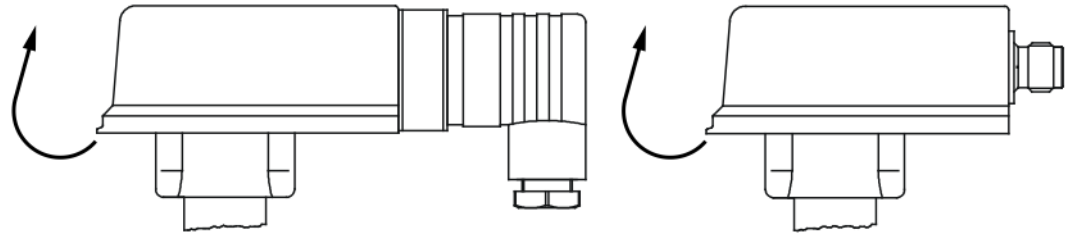

Loosen the locking screw


- Loosen the locking screw (1) (hexagon socket SW2.5 in brass and stainless steel versions and philips head on plastic versions).

Set NO contact

- Position the switching unit until the red arrow (4) is visible at the entry of the switching unit guide.


Note

The switching contact is supplied with a factory setting of NO.

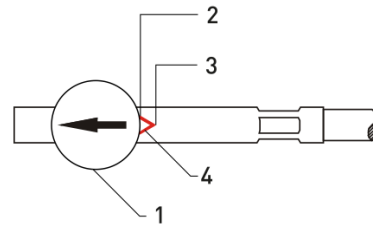

Set NC contact

- Position the switching unit until the white/blue arrow (5) is visible on the entry of the switching unit guide.

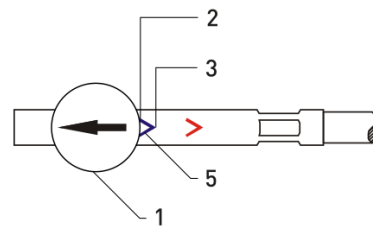

Set the switching unit for low flow

- Position the switching unit in the direction of the arrow head (3).

Set switching point for higher flow

- Position the switching unit in the direction of the end of the arrow (2).

Tighten the locking screw

- Carefully tighten the locking screw (1).
- We recommend using lacquer/thread locker to secure the locking screw after individually setting the switching point.

Close the switching head

- Close the cover until it locks in place.

Maintenance and repair

The flow switch is maintenance-free and cannot be repaired by the user. In the unlikely event of a defect, return the device to the manufacturer for repair.

Disposal



The device is considered an electronic device for disposal in accordance with the European Guidelines and may not be disposed of as domestic garbage.

- Dispose of the device via the channels provided for this purpose.
- Comply with all local and currently applicable laws and regulations.

Technical data

Functional data	Field of use	
	Suitable media	All liquids (not suitable for ammonia)
	Piping diameter	DN 20...200
	Type of switch	Reed contact
	Max. contact rating	AC 230 V, 1 A / DC 48 V, 1 A
	Max. switching capacity	AC 26 VA / DC 20 W
	External supply line protection (EU)	Fuse slow max. 10 A or Circuit breaker max. 13 A Characteristic B, C, D according to or Power source with current limitation of max. 10 A
	Switching point adjustment	manual, supplied with minimum switch-off value
	Tolerance of switching point ranges in the table	±15 %
	Setting range	See switching value table
	Medium temp. (medium cannot freeze)	-20...110 °C
	Nominal pressure	PN 25
	Degree of protection	Protection class III according to EN 60730-1 Housing IP65 according to EN 60529
Environmental conditions	General environmental conditions Operation and storage -20...80 °C Ambient humidity <95 % r.h.	
Standards, directives, and approvals	Product standard EN 60204-1 Safety of machinery - Electrical equipment of machines EU Conformity (CE) CM1T1594xx *) EAC Conformity Eurasia Conformity	
Environmental compatibility	The product environmental declaration CM1E1594 ^{*)} contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).	
Materials / Color	Housing Polyamide, black Screw-in body G½" Brass	
Weight	excl. packaging 0.31 kg	

*) The documents can be downloaded from <http://siemens.com/bt/download>.

Flow switch for direct mounting

Type	QVE1901
Body	Brass CW614N
Paddle / sleeve	PPE+PS Noryl™ 30 % reinforced fiberglass / stainless steel
Process connection	Brass CW614N
Axel	Stainless steel 1.4571
Magnet	Hard ferrite
Seal	NBR

Mounting in T-piece per EN 10242

Nominal size Paddle length		Switching points ON/OFF [m³/h] * 1 max. flow [m³/h]														
		DN 20			DN 25			DN 32			DN 40			DN 50		
Marking	L1 [mm]	ON	OFF	Max.	ON	OFF	Max.	ON	OFF	Max.	ON	OFF	Max.	ON	OFF	Max.
9	40	1.1	0.9	4	1.7	1.5	8.5	2.9	2.6	15	4.2	3.8	25	6.5	6.0	41
15	46	-/-			1.3	1.1	5	2.2	1.9	10	3.2	2.8	18	4.9	4.5	29
20	51	-/-			-/-			1.9	1.6	8	2.8	2.4	14	4.4	4.0	24
30	61	-/-			-/-			-/-			2.1	1.8	10	3.3	3.0	17
40	71	-/-			-/-			-/-			-/-			2.7	2.4	13

*1) Water, 20 °C, horizontal piping, tolerance ±15 %.
ON = Rising flow; OFF = Decreasing flow

Installation with welded sleeve per EN 10241


With G½ Internal threading, 15 mm in length.

Nominal size Paddle length		Switching points ON/OFF [m³/h] * 1 max. flow [m³/h]														
		DN 65			DN 80			DN 100			DN 150			DN 200		
Marking	L1 [mm]	ON	OFF	Max.	ON	OFF	Max.	ON	OFF	Max.	ON	OFF	Max.	ON	OFF	Max.
15	46	8.8	8.5	50	13.8	11.3	80	-/-			-/-			-/-		
20	51	7.4	7.0	45	11.7	9.6	65	18.8	16.3	110	-/-			-/-		
30	61	5.6	5.2	34	9.2	7.7	50	14.6	12.0	80	-/-			-/-		
40	71	4.5	4.2	27	7.5	6.3	40	12.3	10.0	65	27.0	25.0	150	-/-		
50	81	-/-			6.5	5.3	33	10.2	8.0	55	22.8	19.8	130	45.0	43.5	230
60	91	-/-			5.1	4.7	28	8.0	7.1	50	19.5	17.8	110	38.0	36.0	200
70	101	-/-			-/-			6.9	6.3	40	18.0	16.0	100	33.5	32.0	175
80	111	-/-			-/-			6.2	5.9	36	15.7	14.3	90	30.0	29.0	160


*1) Water, 20 °C, horizontal piping, tolerance ±15 %.
ON = Rising flow; OFF = Decreasing flow.

Dimensions

Cutting the paddle

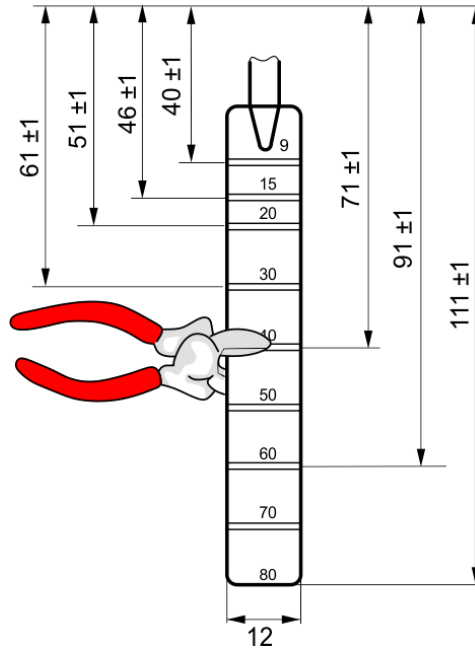

Flow switch

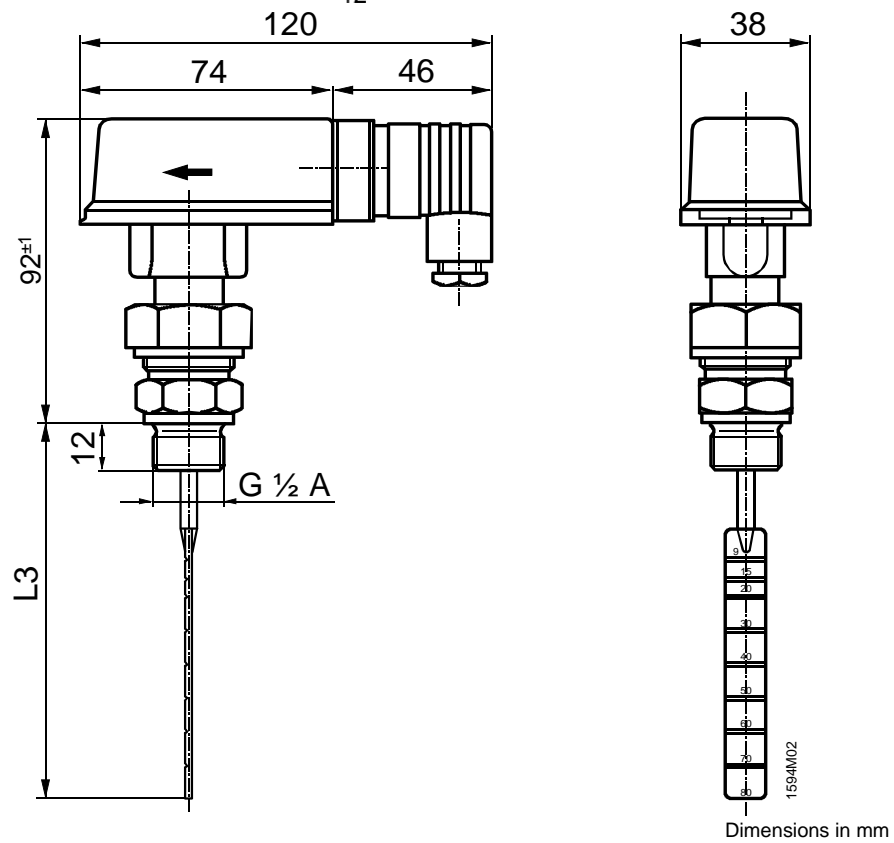

Published by:
 Siemens Switzerland Ltd.
 Smart Infrastructure
 Global Headquarters
 Theilerstrasse 1a
 CH-6300 Zug
 Switzerland
 Tel. +41 58-724 24 24
www.siemens.com/buildingtechnologies

© Siemens Switzerland Ltd 2007
 Delivery and technical specifications subject to change